




CITY OF LODI

PUBLIC WORKS DEPARTMENT

2" WATER SERVICE FOR 1-1/2" OR 2" METER W/ RADIO READ

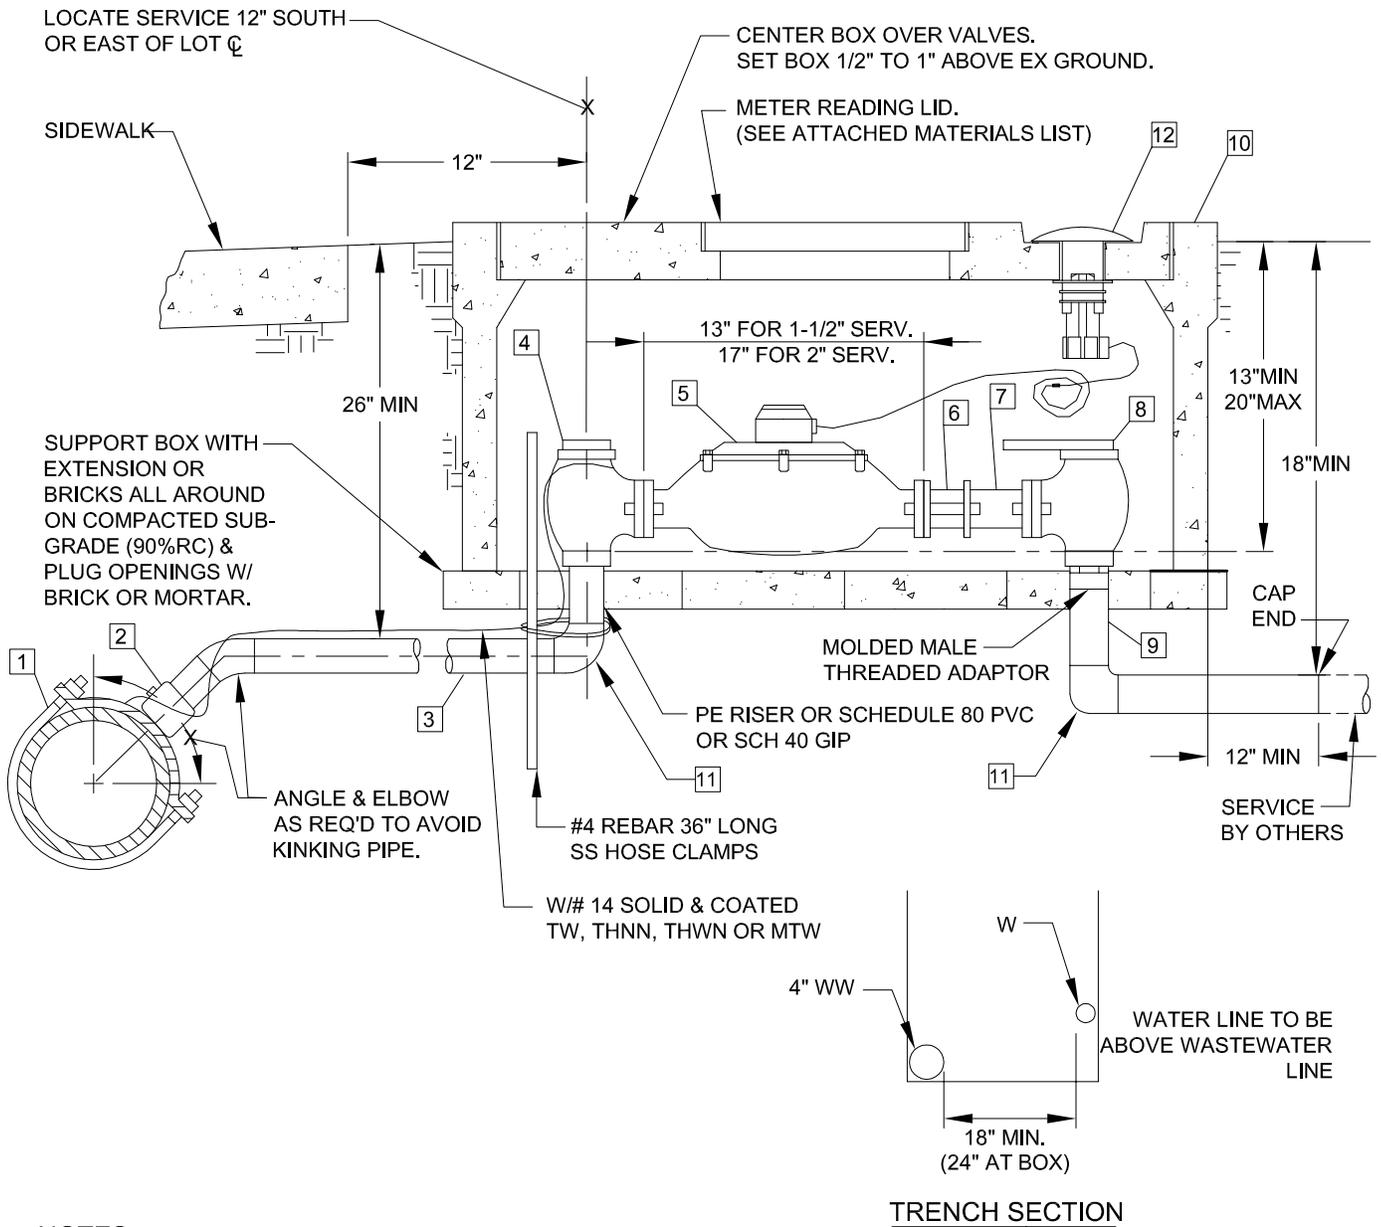

NOTES:

1. MAINTAIN 24" CLEARANCE BETWEEN TAP AND ANY COUPLING, FITTING OR ADJACENT TAP. PLASTIC SERVICES SHALL BE INSTALLED WITH SLACK IN THE LINE. IF THE SERVICE IS INSTALLED IN THE SAME TRENCH AS SANITARY SERVICE, THE WATER SERVICE SHALL BE INSTALLED WITHOUT SPLICES AND THE TRENCH SECTION SHOWN APPLIES:
2. S.S. LINERS REQUIRED ON PE PIPE FITTINGS.
3. BACKFILL SHALL CONFORM TO STD PLAN 501.
4. ALL FITTINGS MUST COMPLY WITH THE LATEST STATE OF CALIFORNIA NO LEAD REQUIREMENTS.

SHEET 1 OF 4

Dr.	No.	Date	Revision	Appr.	Approved By:	STD PLAN 412
	1	9/03	ADDED END CAP		Charlie Swmlsley City Engineer / Deputy Public Works Director RCE No. 52842	
Ch.	2	2/04	REVISED PAGE 4			
Date	3	2/05	REVERSED TRENCH SECTION			
	4	6/10	REVISED PER AB 1953 REQ'S.			
						Date